


Design No. N782

April 19, 2001

Restrained Beam Ratings — 1, 1-1/2, 2, 3 and 4 Hr

Unrestrained Beam Ratings — 1, 1-1/2, 2, 3 and 4 Hr

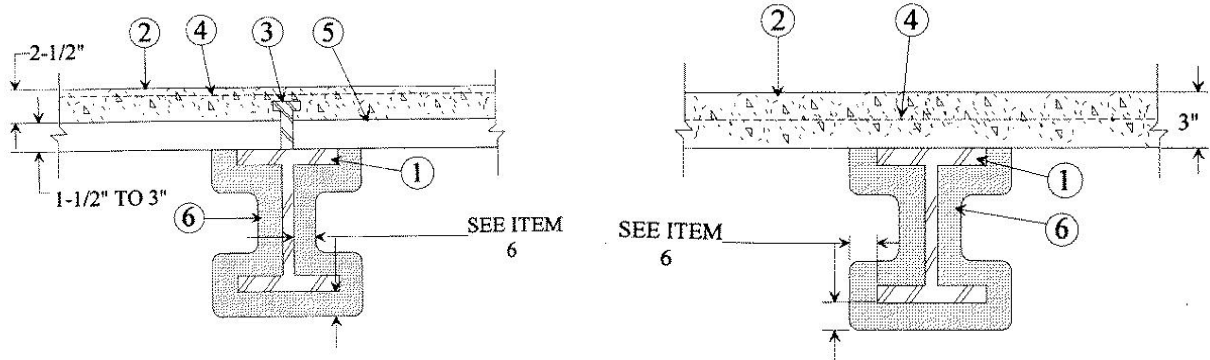

1. **Steel Beam** — W8x28 min size.
2. **Normal Weight or Lightweight Concrete** — Compressive strength, 3000 psi. For normal weight concrete either carbonate or siliceous aggregate may be used. Unit weight, 148 pcf. For lightweight concrete unit weight 110 pcf.
3. **Shear Connector** — (Optional) — Studs, 3/4 in. diam headed type or equivalent per AISC specifications. Welded to the top flange of beam through the steel floor units.
4. **Welded Wire Fabric** — (Optional) — 6x6-10/10 SWG.
5. **Steel Floor and Form Units*** — 1-5/16 in. deep corrugated units; or 1-1/2 to 3 in. deep fluted units welded to beam.
6. **Spray-Applied Fire Resistive Materials*** — Applied by mixing with water and spraying in more than one coat to the beam to the final thicknesses shown below. When fluted or corrugated steel floor units are used, crest areas shall be filled with Spray-Applied Fire Resistive Materials above the beam. Beam surfaces must be clean and free of dirt, loose scale and oil. Min average and min ind. density of 15/14 pcf respectively. Min avg and min ind density of 22/19 pcf respectively for Types Z-106, Z-106/G. Min average and min ind. density of 40/36 pcf respectively for Type Z-146. For method of density determination, see Design Information Section.

The thicknesses of Spray-Applied Fire Resistive Materials shown in the table below are applicable when the beams are supporting solid concrete slabs or floor assemblies containing only fluted floor or form units with lightweight concrete.

Rating Hr	Min Thkns In.	
	Restrained Beam Rating Hr	Unrestrained Beam Rating Hr
1	7/16	7/16
1-1/2	7/16	3/4
2	11/16	1
3	1-3/16	1-5/16
4	1-5/8	1-5/8

The thickness of Spray-Applied Fire Resistive Materials shown in the table below are only applicable when the beams are supporting solid, normal weight, concrete slabs or floor assemblies containing only fluted floor or form units, topped with normal weight concrete.

Rating Hr	Min Thkns In.	
	Restrained Beam Rating Hr	Unrestrained Beam Rating Hr
1	3/8	3/8
1-1/2	3/8	5/8
2	9/16	7/8
3	1	1-7/16
4	1-7/16	2

The thickness of Spray-Applied Fire Resistive Materials shown in the table below are applicable when the thickness applied to the beams' lower flange edges is reduced by one-half and the beams are supporting solid concrete slabs or floor assemblies containing only fluted floor or form units with lightweight concrete.

Rating Hr	Min Thkns In.	
	Restrained Beam Rating Hr	Unrestrained Beam Rating Hr
1	7/16+	7/16+
1-1/2	7/16+	3/4
2	11/16	1
3	1-3/16	1-7/16
4	1-11/16	1-15/16

+ — Thickness applied to beams' lower flange edges shall be a min of 1/4 in.

The thickness of Spray-Applied Fire Resistive Materials shown in the table below are applicable when the thickness applied to the beams' lower flange edges is reduced by one-half and the beams are supporting solid concrete slabs or floor assemblies containing only fluted floor or form units with normal weight concrete.

	Min Thkns In.	
Rating Hr	Restrained Beam Rating Hr	Unrestrained Beam Rating Hr
1	7/16+	7/16+
1-1/2	7/16+	3/4
2	11/16	1-1/16
3	1-3/16	1-11/16
4	1-11/16	2-5/16

+ — Thickness applied to beams' lower flange edges shall be a min of 1/4 in.

ARABIAN VERMICULITE INDUSTRIES — Types MK-6/CBF, MK-6/ED, MK-6/HY, MK-6/HY Extended Set, MK-6s, Sonotex 1, Sonotex 5, Z-106, Z-106/G, Z-146 investigated for exterior use, Sonotex 35.

WR GRACE & CO - CONN

CONSTRUCTION PRODUCTS DIV — Types MK-6/HY, MK-6/HY Extended Set, MK-6s, RG Monokote Acoustic 1, Monokote Acoustic 5, Z-106, Z-106/G, Z-146 investigated for exterior use, Monokote Acoustic 35.

GRACE KOREA INC — Types MK-6/CBF, MK-6/ED, MK-6/HY, MK-6/HY Extended Set, MK-6s Monokote Acoustic 1, Monokote Acoustic 5, Z-106, Z-106/G, Z-146 investigated for exterior use, Monokote Acoustic 35.

*Bearing the UL Classification Mark