


Assembly Rating — 3 Hr
L Rating at Ambient — Less than 1 CFM/Lin Ft
L Rating at 400°F — Less than 1 CFM/Lin Ft
Nominal Joint Width — 2 and 3-1/2 In. (See Item 2A)
Class II Movement Capabilities — 15% Compression or Extension

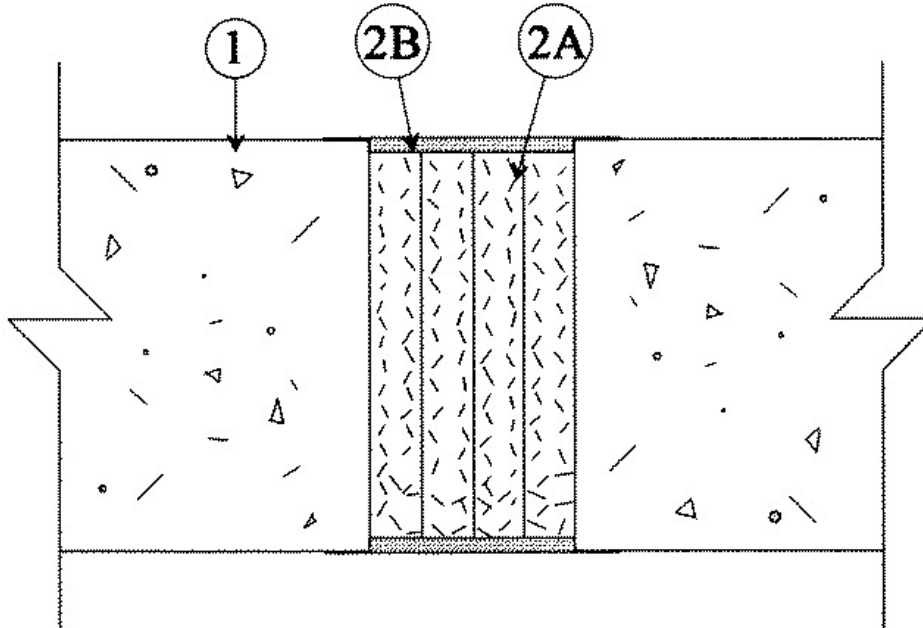

1. **Wall Assembly** — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Joint System** — Max width of joint (at time of installation of joint system) is dependent upon the type of forming material used within the joint system as shown in Item 2A. The joint system is designed to accommodate a max 15 percent compression or extension from its installed width. The joint system shall consist of the following:

A. **Forming Material*** — Min 4 pcf mineral wool batt insulation installed in joint opening as a permanent form. Pieces of batt cut to min width of 4 in. (102 mm) and installed edge-first into joint opening, parallel with joint direction, such that batt sections are compressed min 42 percent in thickness and that the compressed batt sections are recessed from each surface of the wall as required to accommodate the required thickness of fill material. Adjoining lengths of batt to be tightly-butted with butted seams spaced min 24 in. apart along the length of the joint.

Max width of joint (at time of installation of joint system) is dependent upon the manufacturer and type of forming used within the joint system as shown in the table below:

Manufacturer of Forming Material	Type of Forming Material	Width of Joint, In (mm)
Rockwool Malaysia SDN BHD	SAFE Mineral Wool	2 (51)
Rockwool	SAFE Mineral Wool	2 (51)

ROCKWOOL MALAYSIA SDN BHD — SAFE Mineral Wool

ROCKWOOL — SAFE Mineral Wool

B. **Fill, Void or Cavity Material*- Sealant** — Min 1/8 in. (3.2 mm) wet thickness of fill material applied within the joint, flush with each surface of wall and lapping a min 1/2 in. (13 mm) onto each surface of wall.

RECTORSEAL — FlameSafe FS3000 spray, **Metacaulk 1200, 1500** spray or Biostop 750, 800 Spray