

GCP Applied Technologies

MONOKOTE MK-1000 HB Test Reports

| | |
|-----------------------------------|---------|
| ASTM E736 Cohesive Adhesive | Page 2 |
| ASTM E761 Compressive Strength | Page 6 |
| ASTM E859 Air Erosion | Page 9 |
| ASTM E859 High Speed Air Erosion | Page 13 |
| ASTM E759 Deflection | Page 17 |
| ASTM E760 Bond Impact | Page 20 |
| ASTM G21 Mold Resist | Page 23 |
| UL E84 Flame Spread Smoke Develop | Page 31 |



COHESION/ADHESION

MONOKOTE TYPE MK-1000 HB

FIRE RESISTIVE MATERIAL

MADE FOR

GRACE CONSTRUCTION PRODUCTS

**GCP Applied Technologies Inc. (formerly W.R. Grace & Co.)
CAMBRIDGE, MASSACHUSETTS**

MADE BY

FROEHLING & ROBERTSON, INC.

GREENVILLE, SOUTH CAROLINA

Copyright 2014 GCP Applied Technologies Inc. (formerly W.R. Grace & Co.)

COHESION/ADHESION



Significance: This test measures the adhesive force required to separate the material from the base, or the cohesive force within the material and is an indication of the ability of sprayed fire-resistive material to remain in place and resist separation during anticipated service conditions.

The test was conducted using a modified ASTM E-736 "Cohesion/Adhesion of Sprayed Fire-Resistive Material Applied to Structural Members" test procedure.

Results: The average cohesive strength of Monokote Type MK-1000 HB on bare steel was 1527.9 pounds per square foot (psf).

REPORT DETAILS

Dates of Test: November 12, 2013 (mixing & spraying) ; January 13, 2014 (testing)

Identification of Specimen: Bags were selected at random of Monokote Type MK-1000 HB as produced by Construction Products Division, GCP Applied Technologies Inc. (formerly W.R. Grace & Co.). Each bag contained the label of Underwriters' Laboratory, Inc. and was mixed with water in a mechanical mixer in accordance with published instructions. Mixing for two minutes seconds produced a uniform slurry having a mixer density of 39.0 pounds per cubic foot (pcf) and a nozzle density of 39.8 pcf. The procedures represented typical field construction practices and complied with instructions printed on the Monokote Type MK-1000 HB bags.

Description of Test:

I. Apparatus

- A. Metal screw cap 3.25 inches [5.1 centimeters] in diameter and 0.4 inches deep [8.296 sq. in. area], with a hook attached at the center.
- B. Pull Tester accurate to 0.1 lb. (45 grams) with a capacity of 200 lbs (91 kg).
- C. Steel substrate 11.5" (29 cm) x 12.5" (31.8 cm) x 16 gauge to which Monokote Type MK-1000 HB was spray applied and allowed to dry in laboratory conditions 72° F ± 3° F (22° C ± 1.6° C) for a period of 62 days.



II. Test Specimen:

- A. 4 bare steel sheets for bond strength determinations.
- B. An additional steel sheet was sprayed at the same time for formal dry density determination of the sprayed material.

III. Procedure:

- A. After allowing test specimens to cure for a minimum of 28 days under controlled laboratory conditions, the metal screw cap was attached to the surface of the Monokote MK-1000 HB material using a two- part, fast setting epoxy. This epoxy attachment assembly was allowed to fully dry a period of two days prior to testing.
- B. A digitally recording pull tester manufactured by Com-Ten Industries was used to apply the force required to remove the cap assembly from the test panel. A continuous load was applied to the cap assembly using the manually operated screw jacking system. The test was continued until failure occurred, and the maximum force was recorded.

IV. Calculations: The cohesive/adhesive force is calculated as:

$$CA = F/A$$

Where:

CA = Cohesive/adhesive strength, (lbs./ft²)

F = Recorded force, (lb.)

A = Area of the cap assembly, (ft.²)

V. Test Data:

| SPECIMEN | MAXIMUM APPLIED LOAD (lbs) | MAXIMUM STRENGTH (psf) | FAILURE TYPE |
|----------------|----------------------------|------------------------|--------------|
| 1 | 76.5 | 1327.9 | Cohesive |
| 2 | 92.5 | 1605.6 | Cohesive |
| 3 | 96.2 | 1669.9 | Cohesive |
| 4 | 86.9 | 1508.4 | Cohesive |
| AVERAGE | 88.0 | 1527.9 | |

Thickness Tested - 1.25"

Monokote Type MK-1000 HB Density – 17.9 pcf



Official Observers:

Steve Ackerman, PE - Froehling & Robertson, Inc.

Doug Macy - GCP Applied Technologies Inc. (formerly W.R. Grace & Co.)

The data included in this report constitutes all the tests that were witnessed.

Respectfully submitted,

FROEHLING & ROBERTSON, INC.

A handwritten signature in black ink, appearing to read 'R. Turner', is written over a horizontal line.

Ryne Turner, PE
CMT Manager

I certified this as an exact copy of the report generated by F&R in 2014



COMPRESSIVE STRENGTH – ASTM E761-11

MONOKOTE TYPE MK-1000 HB

FIRE RESISTIVE MATERIAL

MADE FOR

GCP APPLIED TECHNOLOGIES INC (FORMERLY W. R. GRACE & CO.)

CAMBRIDGE, MASSACHUSETTS

MADE BY

FROEHLING & ROBERTSON, INC.

GREENVILLE, SOUTH CAROLINA

Copyright 2014 GCP Applied Technologies Inc (formerly W. R. Grace & Co.)



COMPRESSIVE STRENGTH ABSTRACT

Significance: This test measures the compressive strength of sprayed fire - resistive materials and is a measure of the resistance to deformation under a compressive load.

The test was conducted in general accordance with ASTM E761-11 "Compressive Strength of Sprayed Fire - Resistive Materials Applied to Structural Members."

Results: The samples of Monokote MK-1000 HB required an average uniform compressive load of 55.9 pounds per square inch (psi) to compress them to 10 percent deformation.

REPORT DETAILS

Date of Test: November 12 & 13, 2013 (sample preparation); January 13, 2014 (testing)

Identification of Specimen: Bags of Monokote Type MK-1000 HB were selected at random as produced by GCP Applied Technologies Inc (formerly W. R. Grace & Co.). Each bag contained the label of Underwriters' Laboratories, Inc. Each bag of the Monokote Type MK-1000 HB was mixed with water in a mechanical mixer in accordance with the noted instructions to produce a uniform slurry having an average mixer density of 42.5 pounds per cubic foot (pcf) and a nozzle density of 40.1 pcf. The procedures represented typical field construction practices and complied with the instructions printed on the Monokote Type MK-1000 HB bags.

Description of Test:

I. Apparatus

- A. Tinius-Olsen universal testing machine with loading and crosshead travel distance recorder.
- B. Spherical bearing block assembly having a plane bearing surface 6" x 6" square. A steel plate measuring 4" x 4" was used to center loading on the fireproofing material.

II. Test Specimen: Specimens consisted of nominal 7" x 24" x 1.3" Monokote MK-1000 HB applied to a galvanized steel sheet approximately 0.25" in thickness. This resulted in an actual MK-1000 HB thickness of approximately 1.05". Three individual specimens of the prepared panels were tested.

III. Procedure:

- A. After initial room temperature curing for 72 hours, the specimens were force dried in a drying oven maintaining a temperature of 110 ± 10 °F and a relative humidity less than 60% in order to reach constant weight.



- B. The compressive load was applied perpendicular to the face of the test specimen, with the bearing block on top of the specimen. The initial thickness for the deformation calculation was measured between the bearing surface and the steel substrate after the initial load of 0.1 psi had been applied.
- C. The crosshead speed of the testing machine was set at 0.05 inches per minute during compression to 10 percent deformation.

IV. Calculations: The compressive strength is calculated as:

$$CS = L/A$$

Where:

CS = Compressive strength at 10% deformation, (lbs./in²)

L = Recorded compressive load at 10% deformation (lb.)

A = Area of load bearing surface, (in.²)

V. Test Data:

| SPECIMEN | MAXIMUM APPLIED LOAD (lbs) | MAXIMUM STRENGTH (psi) |
|----------------|----------------------------|------------------------|
| 1 | 952 | 59.5 |
| 2 | 907 | 56.7 |
| 3 | 822 | 51.4 |
| AVERAGE | 893.7 | 55.9 |

Thickness Tested – 1.3" (incl. galvanized sheet)

Density – 18.4 pcf

Official Observers:

Steve Ackerman, PE - Froehling & Robertson, Inc.

Doug Macy - GCP Applied Technologies Inc (formerly W. R. Grace & Co.)

The data included in this report constitutes all the tests that were witnessed.

Respectfully submitted,

FROEHLING & ROBERTSON, INC.

Ryne Turner, PE

Ryne Turner, PE
CMT Manager



AIR EROSION – ASTM E859-11

MONOKOTE® MK-1000 HB

FIRE RESISTIVE MATERIAL

MADE FOR

GCP APPLIED TECHNOLOGIES INC (FORMERLY W. R. GRACE & CO.)

CAMBRIDGE, MASSACHUSETTS

MADE BY

FROEHLING & ROBERTSON, INC.

GREENVILLE, SOUTH CAROLINA

Copyright 2014 GCP Applied Technologies Inc (formerly W. R. Grace & Co.)

S I N C E

1 8 8 1
AIR EROSION TEST
ABSTRACT

Significance: The Air Erosion Test measures the effect of a high speed air stream upon fire-resistive materials in plenums during normal service conditions, and evaluates the resistance to dusting, flaking, spalling and delamination of the fire-resistive material.

The test was conducted in accordance with ASTM E-859 “Air Erosion of Sprayed Fire-Resistive Materials Applied to Structural Members.”

Results: Monokote® MK-1000 HB, when subjected to tangential air stream of a velocity of 20 ft./sec [6m/s], resulted in a weight loss of 0.000 grams at one hour, 0.000 grams during the next 5 hours, and 0.001 grams during the next 18 hours (24 hours test time), for a total weight loss of 0.001 grams over the 24 hour test period. **The loss per area of test section for the total test period was 0.000 grams per square foot.** The test density was 17.7 lbs./ft.³ [284 Kg/m³].

REPORT DETAILS

Date of Test: November 20, 2013 (sample preparation); January 8 & 9, 2014 (testing)

Identification of Specimen: Bags of Monokote® MK-1000 HB were selected at random as produced by GCP Applied Technologies Inc (formerly W. R. Grace & Co.). Each bag contained the label of Underwriters' Laboratories, Inc. Each bag of the Monokote® MK-1000 HB was mixed with water in a mechanical mixer in accordance with the noted instructions to produce a uniform slurry having a mixer density of 46.0 pounds per cubic foot (pcf) and a nozzle density of 37.9 pcf. The procedures represented typical field construction practices and complied with the instructions printed on the Monokote® MK-1000 HB bags.

Description of Test:

I. Apparatus

- A. Application Base – 16 gauge galvanized sheet steel 14.5” x 67.5” [368 mm x 1715 mm].
- B. Duct System – A duct made of 12 gauge galvanized steel 8.7 feet long [2.64 meters], rectangular in cross section, with a 10.5” x 63.5” [267 mm x 1613 mm] opening in the top to accept the test sample (4.63 ft² or 0.430 m² exposed area).
- C. Blower – capable of moving air through the entire cross section of the duct at a velocity of 20 ft./sec [6 m/s].
- D. Pitot Tube – used in conjunction with a manometer to measure air velocity in the duct.
- E. Filters – one at the intake end of the duct (blower end) and a collecting filter at the exhaust end of the duct. Filter fabric was 30 denier nylon constructed with 94 ends per inch and 82 picks per inch.

II. Test Specimen:

The test specimen was a 16 gauge galvanized steel sheet 14.5” x 67.5” [368 mm x 1715 mm] onto which the Monokote® MK-1000 HB was spray applied at 0.75” in thickness. The specimen as sprayed was allowed to cure and dry at laboratory conditions for a period of 49 days prior to testing.



III. Procedure:

- A. The collecting filter was dried for one hour at 120 °F [49 °C], weighed, and placed in the apparatus.
- B. The specimen was placed in the duct opening so that its face and the inside face of the duct opening were flush in the same plane. The specimen was sealed in place using silicone rubber adhesive. The edges overlapped the duct opening by 2 inches [50 mm].
- C. The pitot tube was positioned 4 inches [101 mm] from the upstream edge of the specimen at the center line of the duct, and 2 inches [50 mm] below the test specimen.
- D. With both filters in place, the blower was maintained at an average velocity of 20 ft./sec [6 m/s] throughout the duration of the test. The blower was stopped at intervals of 1, 6, and 24 hours. During this stoppage, the filter was removed, dried, and re-weighed to determine the mass gain.

IV. Results:

| WEIGHING TIME | FILTER WEIGHT (g) | WEIGHT LOSS (g) | WEIGHT LOSS (g per ft²) |
|----------------------|--------------------------|------------------------|---|
| 1 HR (initial) | 1.392 | 0.000 | 0.000 |
| 1 HR (final) | 1.392 | | |
| 6 HR (initial) | 1.564 | 0.000 | 0.000 |
| 6 HR (final)) | 1.564 | | |
| 24 HR (initial) | 1.391 | 0.001 | 0.000 |
| 24 HR (final) | 1.392 | | |

Monokote® MK-1000 HB Density – 17.7 pcf



Official Observers:

Steve Ackerman, PE - Froehling & Robertson, Inc.

Jordan Merritt - GCP Applied Technologies Inc (formerly W. R. Grace & Co.)

The data included in this report constitutes all the tests that were witnessed.

Respectfully submitted,

FROEHLING & ROBERTSON, INC.

Ryne Turner, PE

Ryne Turner, PE
CMT Manager



HIGH VELOCITY AIR EROSION – ASTM E859-11

MONOKOTE® MK-1000 HB

FIRE RESISTIVE MATERIAL

MADE FOR

GCP APPLIED TECHNOLOGIES INC (FORMERLY W. R. GRACE & CO.)

CAMBRIDGE, MASSACHUSETTS

MADE BY

FROEHLING & ROBERTSON, INC.

GREENVILLE, SOUTH CAROLINA

Copyright GCP Applied Technologies Inc (formerly W. R. Grace & Co.)



AIR EROSION TEST ABSTRACT

Significance: The High Velocity Air Erosion Test measures the effect of a very high speed air stream upon fire-resistant materials in plenums during extreme service conditions, and evaluates the resistance to dusting, flaking, spalling and delamination of the fire-resistant material.

The test was conducted in accordance with ASTM E-859 "Air Erosion of Sprayed Fire-Resistive Materials Applied to Structural Members." The tested velocity was more than twice that specified in ASTM E-859.

Results: Monokote® MK-1000 HB, when subjected to tangential air stream of a velocity of 45.8 ft./sec [13.7m/s], resulted in a weight loss of 0.000 grams at one hour, 0.000 grams during the next 5 hours, and 0.001 grams during the next 18 hours (24 hours test time), for a total weight loss of 0.001 grams over the 24 hour test period. **The loss per area of test section for the total test period was 0.000 grams per square foot.** The test density was 17.7 lbs./ft.³ [284 Kg/m³].

REPORT DETAILS

Date of Test: November 20, 2013 (sample preparation); February 4 & 5, 2014 (testing)

Identification of Specimen: Bags of Monokote® MK-1000 HB were selected at random as produced by GCP Applied Technologies Inc (formerly W. R. Grace & Co.). Each bag contained the label of Underwriters' Laboratories, Inc. Each bag of the Monokote® MK-1000 HB was mixed with water in a mechanical mixer in accordance with the noted instructions to produce a uniform slurry having a mixer density of 46.0 pounds per cubic foot (pcf) and a nozzle density of 37.9 pcf. The procedures represented typical field construction practices and complied with the instructions printed on the Monokote® MK-1000 HB bags.

Description of Test:

I. Apparatus

- A. Application Base – 16 gauge galvanized sheet steel 14.5" x 67.5" [368 mm x 1715 mm].
- B. Duct System – A duct made of 12 gauge galvanized steel 8.7 feet long [2.64 meters], rectangular in cross section, with a 10.5" x 63.5" [267 mm x 1613 mm] opening in the top to accept the test sample (4.63 ft² or 0.430 m² exposed area).
- C. Blower – capable of moving air through the entire cross section of the duct at a velocity of 45.8 ft./sec [13.7 m/s].
- D. Pitot Tube – used in conjunction with a manometer to measure air velocity in the duct.
- E. Filters – one at the intake end of the duct (blower end) and a collecting filter at the exhaust end of the duct. Filter fabric was 30 denier nylon constructed with 94 ends per inch and 82 picks per inch.

II. Test Specimen:



The test specimen was a 16 gauge galvanized steel sheet 14.5" x 67.5" [368 mm x 1715 mm] onto which the Monokote® MK-1000 HB was spray applied at 0.75" in thickness. The specimen as sprayed was allowed to cure and dry at laboratory conditions for a period of 76 days prior to testing.

III. Procedure:

- A. The collecting filter was dried for one hour at 120 °F [49 °C], weighed, and placed in the apparatus.
- B. The specimen was placed in the duct opening so that its face and the inside face of the duct opening were flush in the same plane. The specimen was sealed in place using silicone rubber adhesive. The edges overlapped the duct opening by 2 inches [50 mm].
- C. The pitot tube was positioned 4 inches [101 mm] from the upstream edge of the specimen at the center line of the duct, and 2 inches [50 mm] below the test specimen.
- D. With both filters in place, the blower was maintained at an average velocity of 45.8 ft./sec [13.7 m/s] throughout the duration of the test. The blower was stopped at intervals of 1, 6, and 24 hours. During this stoppage, the filter was removed, dried, and re-weighed to determine the mass gain.

IV. Results:

| WEIGHING TIME | FILTER WEIGHT (g) | WEIGHT LOSS (g) | WEIGHT LOSS (g per ft²) |
|----------------------|--------------------------|------------------------|---|
| 1 HR (initial) | 1.451 | 0.000 | 0.000 |
| 1 HR (final) | 1.451 | | |
| 6 HR (initial) | 1.636 | 0.000 | 0.000 |
| 6 HR (final)) | 1.636 | | |
| 24 HR (initial) | 1.752 | 0.001 | 0.000 |
| 24 HR (final) | 1.753 | | |

Monokote® MK-1000 HB Density – 17.7 pcf



Official Observers:

Steve Ackerman, PE - Froehling & Robertson, Inc.

Jordan Merritt - GCP Applied Technologies Inc (formerly W. R. Grace & Co.)

The data included in this report constitutes all the tests that were witnessed.

Respectfully submitted,

FROEHLING & ROBERTSON, INC.

Ryne Turner, PE

Ryne Turner, PE
CMT Manager



DEFLECTION TEST – ASTM E759-11

MONOKOTE® MK-1000 HB

FIRE RESISTIVE MATERIAL

MADE FOR

GCP APPLIED TECHNOLOGIES INC (FORMERLY W. R. GRACE & CO.)

CAMBRIDGE, MASSACHUSETTS

MADE BY

FROEHLING & ROBERTSON, INC.

GREENVILLE, SOUTH CAROLINA

Copyright 2014 GCP Applied Technologies Inc (formerly W. R. Grace & Co.)



DEFLECTION TEST ABSTRACT

Significance: The Deflection Test measures the behavior of sprayed fire-resistive materials when the floor construction to which it is applied is subjected to deflection and evaluates such phenomena as spalling and delamination under bending stress. It is an indication of the ability of the sprayed fire-resistive material to remain in place and resist removal during anticipated service conditions.

The test was conducted in accordance with ASTM E-759-11 "Effect of Deflection on Sprayed Fire-Resistive Materials Applied to Structural Members."

Results: Monokote® MK-1000 HB did not crack, spall, or delaminate and remained unchanged in every aspect when the backing to which it was applied was subjected to deflection of 1/120th of the span. The test density was 17.7 pounds per cubic foot (lbs./ft.³).

REPORT DETAILS

Date of Test: November 20, 2013 (sample preparation); January 7, 2014 (testing)

Identification of Specimen: Bags of Monokote® MK-1000 HB were selected at random as produced by GCP Applied Technologies Inc (formerly W. R. Grace & Co.). Each bag contained the label of Underwriters' Laboratories, Inc. Each bag of the Monokote® MK-1000 HB was mixed with water in a mechanical mixer for approximately 90 seconds in accordance with the noted instructions to produce a uniform slurry having a mixer density of 46.0 pounds per cubic foot (pcf) and a nozzle density of 37.9 pcf. The procedures represented typical field construction practices and complied with the instructions printed on the Monokote® MK-1000 HB bags.

Description of Test:

I. Apparatus

- A. Supports - A rigid base to provide 4 inches [101 mm] bearing and a clear span between supports of 10 feet.
- B. Load - Pre-weighed bars of iron.
- C. Deflection Gauge - a dial micrometer graduated to 0.001 inch.

II. Test Specimen:

The test specimen was a cellular steel deck of non-composite type, nominal 1.5 inches deep, 24 inches wide by 12 feet long, consisting of an 18 gauge galvanized steel fluted top section and a 20 gauge steel flat bottom section welded together to form four cells 6 inches on center. The fire-resistive material was then spray applied to the underside of the steel deck to a 3/4 inch thickness. The Monokote® MK-1000 HB was not applied to an area 12 inches from each end of the specimen in order to permit the steel deck to bear directly on the supports of the test fixture.



III. Procedure:

The prepared specimen was allowed to condition at atmospheric conditions for a period of 48 days prior to testing. The test specimen was placed on the test fixture supports to simulate field conditions of a floor construction with sprayed Monokote® MK-1000 HB fire-resistive material as the lower surface. The specimen had a clear span between supports of 10 feet. A vertical load was applied to the upper face of the specimen to develop a deflection of 1/120 of the clear span, or 1.0 inch. To measure the deflection, the initial reading of the dial micrometer was recorded prior to the application of the load, and deformation monitored as the load was applied.

IV. Results:

The test specimen was examined upon completion of the test. No evidence of cracking, spalling, delamination, loss of bond or any other change in the Monokote® MK-1000 HB was observed after being subjected to the above described test procedure.

Official Observers:

Steve Ackerman, PE - Froehling & Robertson, Inc.

Michael Morgan - GCP Applied Technologies Inc (formerly W. R. Grace & Co.)

Jordan Merritt – GCP Applied Technologies Inc (formerly W. R. Grace & Co.)

The data included in this report constitutes all the tests that were witnessed.

Respectfully submitted,

FROEHLING & ROBERTSON, INC.

Ryne Turner, PE

Ryne Turner, PE
CMT Manager



BOND IMPACT TEST – ASTM E760-11

MONOKOTE® MK-1000 HB

FIRE RESISTIVE MATERIAL

MADE FOR

GCP APPLIED TECHNOLOGIES INC (FORMERLY W. R. GRACE & CO.)

CAMBRIDGE, MASSACHUSETTS

MADE BY

FROEHLING & ROBERTSON, INC.

GREENVILLE, SOUTH CAROLINA

Copyright 2014 GCP Applied Technologies Inc (formerly W. R. Grace & Co.)



BOND IMPACT TEST ABSTRACT

Significance: The Bond Impact Test measures the behavior of sprayed fire-resistive materials when the floor construction to which it is applied is subjected to the impact of shock loading, and evaluates adhesion and resistance to spalling, cracking, and delamination. It is an indication of the ability of the sprayed fire-resistive material to remain in place and resist removal during anticipated service conditions.

The test was conducted in accordance with ASTM E-760-11 “Effect of Impact on Bonding of Sprayed Fire-Resistive Materials Applied to Structural Members.”

Results: Monokote® MK-1000 HB did not crack, spall, or delaminate and remained unchanged in every aspect when the floor construction to which it was applied was subjected to an impact shock loading of 240 foot-pounds (60 pounds dropped from 4 feet), or 33 Kilogram-meters (27.2 Kilograms dropped from 1.2 meters). The test density was 17.7 lbs./ft.³ [284 Kg/m³].

REPORT DETAILS

Date of Test: November 20, 2013 (sample preparation); January 8, 2014 (testing)

Identification of Specimen: Bags of Monokote® MK-1000 HB were selected at random as produced by GCP Applied Technologies Inc (formerly W. R. Grace & Co.). Each bag contained the label of Underwriters' Laboratories, Inc. Each bag of the Monokote® MK-1000 HB was mixed with water in a mechanical mixer in accordance with the noted instructions to produce a uniform slurry having a mixer density of 46.0 pounds per cubic foot (pcf) and a nozzle density of 37.9 pcf. The procedures represented typical field construction practices and complied with the instructions printed on the Monokote® MK-1000 HB bags.

Description of Test:

I. Apparatus

- A. Supports – a rigid base to provide 4 inches [101 mm] bearing and a clear span between supports of 10 feet [3.05 meters].
- B. Impact Instrument – a steel-shot filled leather bag weighing 60 lbs. (27.2 kg).
- C. Measuring Stick – used to accurately measure the height of drop.

II. Test Specimen:

The test specimen consisted of a complete deck assembly of a cellular steel deck and a concrete topping. The cellular steel deck was of the non-composite type, nominal 1.5 inches



deep, 24 inches wide by 12 feet long [38 mm x 610 mm x 3.66 meters], consisting of an 18 gauge galvanized steel fluted top section and a 20 gauge steel flat bottom section welded together to form four cells 6 inches [152 mm] on center. The concrete was nominal 3,000 psi [211 Kg/cm²] mix, poured 2.5 inches deep [63 mm] as measured to the top plane of the steel decking. The Monokote® MK-1000 HB fire-resistive material was then spray applied to the underside of the steel deck to a 3/4 inch [19 mm] thickness. The Monokote® MK-1000 HB was not applied to an area 12" [305 mm] from each end of the specimen in order to permit the steel deck to bear directly on the supports of the test fixture.

III. Procedure:

The prepared specimen was allowed to condition at atmospheric conditions for a period of 28 days prior to testing. The test specimen was placed on the fixture supports to simulate field conditions of a floor construction with sprayed Monokote® MK-1000 HB fire-resistive material as the lower surface and the concrete as the upper surface. The specimen had a clear span between supports of 10 feet [3.05 meters]. An impact load was applied to the upper face of the specimen by dropping the instrument from a height of 4 feet [1.22 meters]. The height of the bag was measured from the upper face of the specimen prior to release.

IV. Results:

The test specimen was examined upon completion of the test. No evidence of cracking, spalling, delamination, loss of bond or any other change in the Monokote® MK-1000 HB was observed after being subjected to the above described test procedure

Official Observers:

Steve Ackerman, PE - Froehling & Robertson, Inc.

Michael Morgan - GCP Applied Technologies Inc (formerly W. R. Grace & Co.)

The data included in this report constitutes all the tests that were witnessed.

Respectfully submitted,

FROEHLING & ROBERTSON, INC.

Ryne Turner, PE

Ryne Turner, PE
CMT Manager



Accugen Laboratories, Inc.

FINAL REPORT

ASTM G21

ASTM Designation: G21-09 "Standard Practice for determining Resistance of Synthetic polymeric materials to Fungi"

TEST AGENT

Monokote MK-1000 HB Lot# A

TESTING LABORATORY

Accugen Laboratories, Inc.
50 West 75th street, Ste 209
Willowbrook, IL 60527
Tel: 630-789-8105
Toll free: 800-282-7102
Fax: 630-789-8104
Web address: www.accugenlabs.com
Email: info@accugenlabs.com

SPONSOR

GCP Applied Technologies Inc.
(Formerly W R Grace)
62 Whittemore Ave.
Cambridge, MA, 02140
Contact: Bret Simpson
Phone: 617-498-4538
Fax: 617-498-4360
Email:
Bret.t.simpson@grace.com

DATE RECEIVED

11-12-13

DATE REPORTED

12-17-13 & 01-16-14

TABLE OF CONTENT

FINAL REPORT - COVER PAGE.....1

TABLE OF CONTENTS.....2

INTRODUCTION.....3

TEST SUMMARY.....3

TEST CONDITIONS.....3

STUDY DATES AND FACILITIES.....4

RECORDS TO BE MAINTAINED.....4

TEST PROCEDURE.....4

RESULTS.....6

CONCLUSIONS.....6

PICTURES.....7

TEST: Fungus resistance test as per ASTM G21-09

METHOD REFERENCE: ASTM Designation: G21-09 "Standard Practice for determining Resistance of Synthetic polymeric materials to Fungi"

INTRODUCTION: The purpose of this study is to assess the potential for mold growth on products and to evaluate that the products do not provide a food source to support the mold growth.

SUMMARY: Test samples were inoculated with composite of five different mold suspensions and were incubated under conditions favorable to mold growth. Samples were examined and rated for visual growth.

TEST MATERIALS: Monokote MK-1000 HB Lot# A

TEST CONDITIONS:

| | | |
|------------------------------------|-------------------------|--------------|
| <u>Challenge Organisms:</u> | Aspergillus niger | ATCC # 9642 |
| | Penicillium pinophilum | ATCC # 11797 |
| | Chaetomium globosum | ATCC # 6205 |
| | Trichoderma virens | ATCC # 9645 |
| | Aureobasidium pullulans | ATCC # 15233 |

Contact temperature: Room temperature (28 to 30 °C)
Humidity 85% +

Media and reagents:

- Sabauroud's dextrose agar
- Nutrient Salt solutions and agar
- Sterile deionized water

STUDY DATES AND FACILITIES:

The laboratory phase of this test was performed at ACCUGEN LABORATORIES, INC, 50 West 75th Street, Willowbrook, IL 60527 from. Study was initiated on 11/12/13. The study completion date is the date the study director signed the final report which is 12/17/13.

RECORDS TO BE MAINTAINED:

All testing data, test material records, the final report, and correspondence will be stored in the archives.

TEST PROCEDURE:

Nutrient-salts agar was poured into suitable sterile dishes to provide a solidified agar layer. 2x2 inches pieces of test samples were placed on the surface of nutrient salts agar (pH 6.5). Testing was carried out in triplicate. The surface, including the surface of the test specimens, were inoculated with the composite spore suspension by spraying the suspension so that the entire surface is moistened with the spore suspension. Fungal suspension was composed of equal volume of five mold suspensions at a concentration of 1,000,000 spores \pm 200,000 per ml

Negative Control:

- Three pieces of test sample were placed on Nutrient salt agar without inoculating any fungal suspension.
- Three plates of Nutrient salt agar were placed along the test as media negative control.

Sponsor: GCP Applied Technologies Inc. WR Grace
(Formerly WR Grace)

Viability Control:

Three Sabouraud dextrose agar plates were inoculated by spraying the suspension to cover the entire surface with the spore suspension.

There was copious growth on all three of the growth media plates to confirm the viability of the inoculums.

Positive Control:

Sterilized Wood spatula, 1 x 2 in were placed on hardened nutrient-salts agar in separate Petri dishes. Each of them was inoculated with the spore suspension by spraying the suspension to cover the entire surface with the spore suspension.

There was copious growth on control specimens.

INCUBATION CONDITIONS:

Incubation—The inoculated test specimens and controls were covered and incubated at 28 to 30°C and 85% relative humidity for 28 days & 60 days.

Observation for Visible Effects—Visible effects were recorded and rated.

Growth observed was scored by amount of growth on Specimens as follows:

| Observation | Rating |
|---|--------|
| None | 0 |
| Traces of growth (less than 10 %) | 1 |
| Light growth (10 to 30 %) | 2 |
| Medium growth (30 to 60 %) | 3 |
| Heavy growth (60 % to complete overage) | 4 |

TEST RESULTS: See Table 1 and figures.

Sample was tested in triplicate. All three replicates of the sample showed no growth in 28 days & 60 days.


Table 1: Visual Rating of Fungal growth Observed

| Sample | 7 days | | | 14 days | | | 21 days | | | 28 days | | | 60 days | | |
|---|--------|---|---|---------|---|---|---------|---|---|---------|---|---|---------|---|---|
| Lab# 100753 Monokote MK- 1000 HB Lot# A | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Negative Control | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Viability Control | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| Positive Control (Wood Spatula) | 2 | 2 | 2 | 3 | 3 | 3 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |

Controls were satisfactory. Positive control and Viability control showed heavy growth. No unusual changes in the physical appearance of the sample were observed.

CONCLUSION:

Test sample do not provide food source that support mold growth. The sample showed no growth of fungi inoculated .The product was found resistant to fungi tested when incubated at nutrient salt agar medium.



T. Naqvi M.S Microbiology, M (ASCP). Study Director

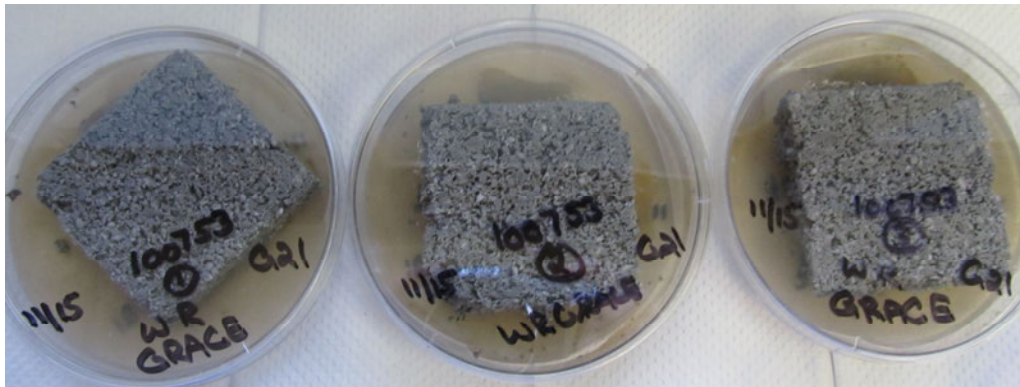


Fig1: Lab# 100753 at Nutrient Salt agar inoculated with fungal spores at 28 days in triplicate


Test sample did not support any fungal growth. © Accugen labs



Fig2: Spores Viability control - heavy fungal growth © Accugen labs



Fig3: Positive control - heavy fungal growth © Accugen labs



**BLPR.R4339
Cementitious Cement and Plaster Mixtures**

[Page Bottom](#)

Cementitious Cement and Plaster Mixtures

[See General Information for Cementitious Cement and Plaster Mixtures](#)

GCP APPLIED TECHNOLOGIES INC
FIRE OPERATING UNIT
62 WHITTEMORE AVE
CAMBRIDGE, MA 02140 USA

R4339

Cementitious mixtures applied to inorganic reinforced cement board and/or foamed plastic.

Applied To Inorganic Reinforced Cement Board

| | MK-4 | MK-5 | RG | Type 105 | KM-106 |
|-----------------|------|------|----|----------|--------|
| Flame Spread | 10 | 10 | 0 | 0 | 0 |
| Smoke Developed | 0 | 0 | 0 | 0 | 0 |

| | Z-3306G | MK-6/HY or MK-6/HB or MK-10/HB or MK-10/HB ES or MK-6/HY ES | Z-106/HY | MK-6 GF or MK-6 GF Extended Set | MK-6s or Z-106G or MK-1000/HB or MK-1000/HB Extended Set | AK-1 |
|-----------------|---------|---|----------|---------------------------------|--|------|
| Flame Spread | 0 | 0 | 5 | 0 | 0 | 0 |
| Smoke Developed | 0 | 0 | 0 | 0 | 0 | 0 |

| | Type 105 | Type Z-106 | Type KM-601 | Type Z-146, Z-146 NPP, Z-146PC, Z-146T, Z-156, Z-156PC, Z-156T | Monokote Acoustic 1 | Monokote Acoustic 5 | Monokote Acoustic 35 |
|-----------------|----------|------------|-------------|--|---------------------|---------------------|----------------------|
| Flame spread | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Smoke developed | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

| | Applied to Inorganic Reinforced Cement Board in a Max Thk of 1 In. Type Z-3300TB+, ++ | |
|-----------------|--|--|
| Flame Spread | 5 | |
| Smoke Developed | 0 | |

| | Applied to Inorganic Reinforced Cement Board In a Max Thk of 1/2 in. Type Z-Acoustical Plaster | |
|-----------------|---|--|
| Flame Spread | 0 | |
| Smoke Developed | 0 | |

+ FOR SURFACE BURNING CHARACTERISTICS APPLIED OVER FOAMED PLASTIC, SEE CLASSIFICATION MARKING OF UNDERWRITERS LABORATORIES INC. ON PRODUCT OR CARTON.

++ Systems utilizing cementitious mixture covering over 2 in. thickness of foamed plastic, fire tested in accordance with the International Conference of Building Officials Research Committee Acceptance Criteria for Foam Plastics under Section 1717 (b) of the 1976 Uniform Building Code.

| | Applied Over 2 In. Thk Foamed Plastic |
|--|--|
| | |

| | In. a Min Thkns of 1/2 In. Type Z-3300TB†† |
|-----------------|---|
| Flame spread | 10 |
| Smoke developed | 0 |

* A Foamed plastic formed by the simultaneous spraying of two liquid components (CPR-485, Component "A" and CPR-485, Component "B") as manufactured by The Upjohn Company, CPR Division. This foamed plastic has values of Over 200 for flame spread, 15 for fuel contributed and Over 500 for smoke developed.

* A1 Systems utilizing 3/4 in. thick cementitious mixture covering over 2 in. thickness of foamed plastic, fire tested in accordance with the Uniform Building Code Standard 26-3.

| | Applied Over 2 In. Thk Foamed Plastic * In. a Min Thkns of 1/2 in. Type Z3300TB* |
|-----------------|---|
| Flame spread | 5 |
| Smoke developed | 0 |

* Foamed plastic in the form of boards identified as Type B and manufactured by GCP Applied Technologies Inc. and bearing the Fire Hazard Classification Marking of Underwriters Laboratories Inc. The 2 in. thickness of foamed plastic exhibited values of 5 for flame spread, not determinable for fuel contributed, and 40 for smoke developed, while material remained in original test position; ignition of molten residue on the furnace floor resulted in flame travel equivalent to calculated Flame Spread Classification of 100 and Smoke Developed Classification of Over 500.

** A system utilizing 1/2 in. thickness of cementitious mixture covering 2 in. thickness of foamed plastic,thickness of foamed plastic.

**FOR SURFACE BURNING CHARACTERISTICS SEE CLASSIFICATION MARK
OF UL ON PRODUCT OR CARTON**

Last Updated on 2016-09-23

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2016 UL LLC

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2016 UL LLC".