


**Assembly Rating—3 Hr**  
**L Rating at Ambient — Less than 1 CFM/Lin Ft**  
**L Rating at 400 F — Less than 1 CFM/Lin Ft**  
**Nominal Joint Width—2 In.**  
**Class II Movement Capabilities—15% Compression or Extension**

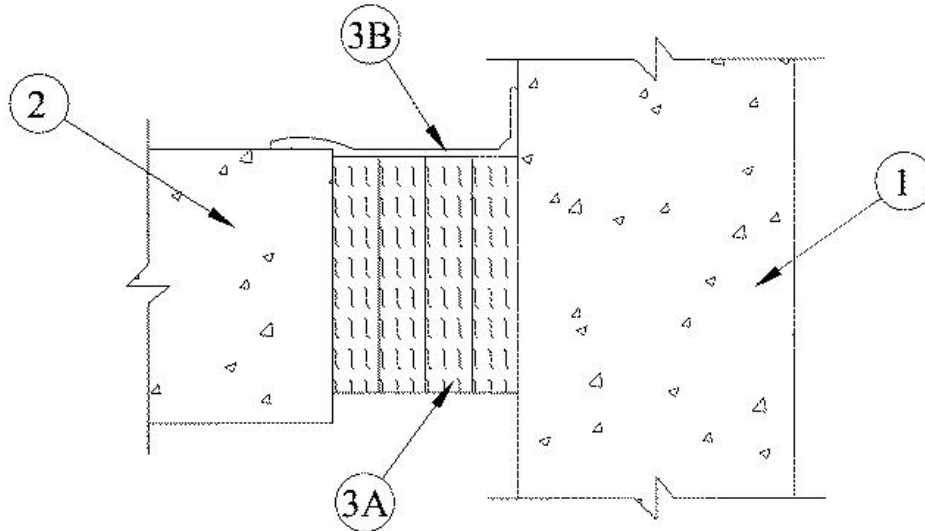

**1. Wall Assembly** — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100 -150 pcf or 1600-2400 kg/m<sup>3</sup>) structural concrete. Wall may also be constructed of any UL Classified **Concrete Blocks\***.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

**2. Floor Assembly** — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100 -150 pcf or 1600-2400 kg/m<sup>3</sup>) structural concrete.

**3. Joint System** — **Max separation between edge of floor and face of wall (at time of installation of joint system) is 2 in. (51 mm). The joint system is designed to accommodate a max 15 percent compression or extension from it's installed width.** The joint system shall consist of the following:

**A. Forming Material\*** — Min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt insulation installed in joint opening as a permanent form. Pieces of batt cut to min width of 4 in. (102 mm) and installed edge-first into joint opening, parallel with joint direction, such that batt sections are compressed min 42 percent in thickness and that the compressed batt sections are recessed from top surface of the floor as required to accommodate the required thickness of fill material. Adjoining lengths of batt to be tightly-butted with butted seams spaced min 24 in. (610 mm) apart along the length of the joint.  
**INDUSTRIAL INSULATION GROUP L L C** — MinWool-1200 Safing

**ROCKWOOL MALAYSIA SDN BHD** — SAFE Mineral Wool

**ROCKWOOL** — SAFE Mineral Wool

**THERMAFIBER INC** — SAF Mineral Wool

**B. Fill, Void or Cavity Material\*— Spray** — Min 1/8 in. (3.2 mm) wet thickness of fill material applied within the joint, flush with top surface of floor and lapping a min 1/2 in. onto the top surface of the floor and side of wall.

**RECTORSEAL** — FlameSafe FS3000, [Metacaulk 1200, 1500](#) or Biostop 750, 800 Spray