


ANSI/UL2079	CAN/ULC S115
Assembly Rating — 3 Hr	F Rating — 3 Hr
Nominal Joint Width — 1 in.	FT Rating — 3 Hr
Class II or III Movement Capabilities — 25 % Compression or Extension	FH Rating — 0 Hr
	FTH Rating — 0 Hr
	Nominal Joint Width — 25 mm
	Class II or III Movement Capabilities — 25 % Compression or Extension

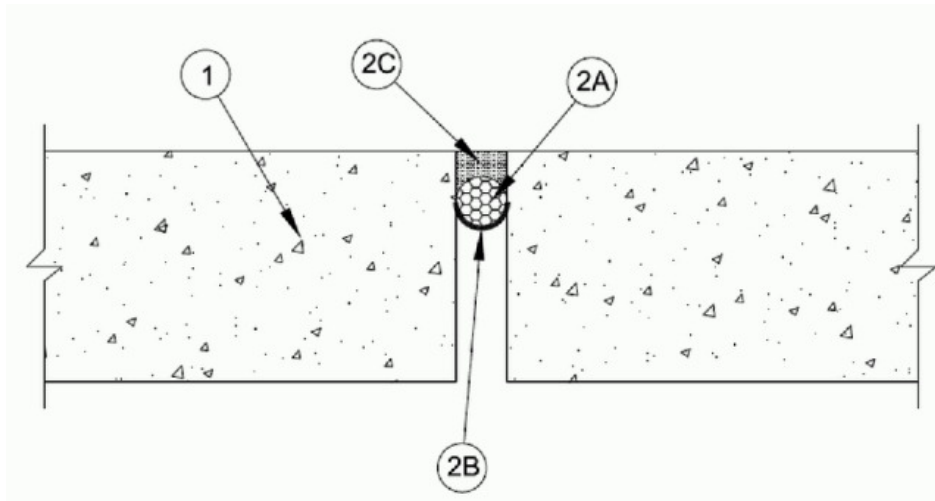

1. Floor Assembly — Min 6 in. (152 mm) thick reinforced lightweight or normal weight (100-150 pcf 1600-2400 kg/m³) structural concrete.

2. Joint System — Max width of joint (at time of installation of joint system) is 1 in. (25 mm) The joint system is designed to accommodate a max 25 percent compression or extension from it's installed width. The joint system shall consist of the following:

A. Fill, Void or Cavity Material* — Joint Strip — Nom 1/16 in. (1.5 mm) thick by 2 in. (51 mm) wide strip of intumescent material faced on one side with an elastomeric backing strip. Strip is formed into a "u-shape" along its length and friction fit into joint opening such that the base of the "u" is recessed approximately 1-9/16 in. (39 mm) from the top surface of floor.

RECTORSEAL — [Metacaulk Joint Strip](#), Biostop Joint Strip or FlameSafe Joint Strip

B. Packing Material — Foam backer rod firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor as required to accommodate the required thickness of fill material.

C. Fill, Void or Cavity Material* — Sealant - Min 1/4 in. (6 mm) thickness of fill material applied within the joint, flush with top surface of floor.

BASF CONSTRUCTION CHEMICAL L L C — MasterSeal NP1 Sealant

RECTORSEAL — [Metacaulk 1000, 150+](#), 350i, 835+, 1200, Biostop 500+, [150+](#), 350i, 100, 800, 750, FlameSafe 900+, 1900, 4000.

SIKA CORPORATION — Sikaflex 2C NS, Sikaflex 1-A

*,+ Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.