


F Rating — 4 Hr
T Ratings— 2-3/4 and 4 Hr (See Item 3)

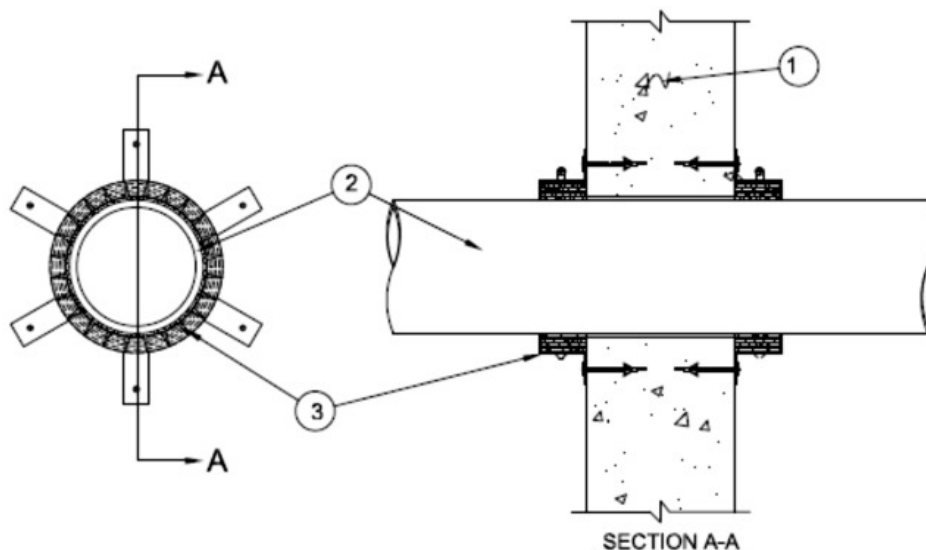

1. **Wall Assembly** — Min 6 in. (152 mm) thick lightweight or normal weight (100-150 pcf or 1600 - 2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 5 in. (127 mm). See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Through Penetrants** — One nonmetallic pipe to be centered within the firestop system. Pipe to be installed either concentrically or eccentrically within the firestop system. The annular space between the pipe and periphery of opening shall be min 0 in. (point contact) to max 1/2 in. (13 mm). Pipe to be rigidly supported on both sides of wall assembly. The following types and sizes of nonmetallic pipes may be used:

A. **Polyvinyl Chloride (PVC or uPVC) Pipe** — Nom 4 in. (102 mm) diam (or smaller). Schedule 40 solid core PVC or uPVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

B. **Unplasticized Polyvinyl Chloride (uPVC) Pipe** — Nominal 4 in. (102 mm) diameter (or smaller), SDR 41, SDR 33, or SDR 26 uPVC pipe for use in closed (process or supply) or vented (drain, waste, or vent) piping systems.

3. **Firestop System** — The firestop system shall consist of the following:

A. **Fill, Void or Cavity Materials * - Caulk** — Min thickness of 5/8 in. (16 mm) of caulk applied within annulus, flush with both surfaces of wall assembly.

RECTORSEAL — [Metacaulk 1000](#)

B. **Firestop Device*** — Galv steel collar lined with an intumescent material sized to fit specific diam of the through penetrant. Device to be installed around through penetrant in accordance with accompanying installation instructions. Device incorporates anchor tabs for securement to both surfaces of the wall by means of 1/4 in. diam by 1-1/4 in. (32 mm) long masonry type anchors.

RECTORSEAL — [Metacaulk Pipe Collar](#)

T Rating is 2-3/4 hours when Item 3 is used.

3A. **Firestop System — (Alternate to Item 3)** — The firestop system shall consist of the following:

A. **Fill, Void or Cavity Materials * - Caulk** — (Optional) — Min thickness of 5/8 in. (16 mm) of caulk applied within annulus flush with both surfaces of wall assembly.

RECTORSEAL — [Metacaulk 1000](#)

B. **Fill, Void or Cavity Material* - Wrap Strip** — Two layers of nom 1/4 in. (6 mm) thick by 2 in. (51 mm) wide intumescent wrap strip individually wrapped around the outer circumference of the pipe such that wrap strip is flush with both surfaces of wall. Butted ends in successive layers shall be offset. Wrap strip secured with tape, wire or tie wire.

RECTORSEAL — [Metacaulk Wrap Strip](#)

C. **Steel Collar** — Collar fabricated from coils of precut min 0.016 in. thick (No. 28 gauge) galv steel available from fill material manufacturer. Collar shall be nom 2 in. (51 mm) deep with 1 in.(25 mm) wide by 1-1/2 in. (38 mm) long anchor tabs on 4 in. (102 mm) centers to secure to both surfaces of wall. In addition, collar contains retainer tabs, 1/2 in. (13 mm) wide by 3/4 in. (19 mm) long, located opposite the anchor tabs. Collar shall be wrapped over the wrap strip, overlapping min 1 in. The retainer tabs are folded 90 deg towards the pipe to maintain the annular space around the pipe and to retain the wrap strip. Collar secured to both surfaces of wall at each anchor tab by means of 1/4 in. diam by 1-1/4 in. (32 mm) long masonry type anchors in conjunction with 1/4 in. by 5/8 in. (6 by 16 mm) diam washers.

T rating is 4 hr when Item 3A is used.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

+